


\*\*\* ALL FUTURE TREES TO BE PLANTED AWAY FROM UTILITY LINES, DOWNSPOUT LINES, SUMP PUMP LINES, AND GRAVEL TRENCH \*\*\*

DISTURBANCE LIMITS:  
 TOTAL DISTURBANCE = 18,555 S.F. OR 0.426 AC.  
 TOTAL DISTURBANCE WITHIN 25' BUFFER SETBACK = 990 S.F. OR 0.023 AC.  
 TOTAL DISTURBANCE WITHIN 25' ADDITIONAL SETBACK = 4,278 S.F. OR 0.098 AC.

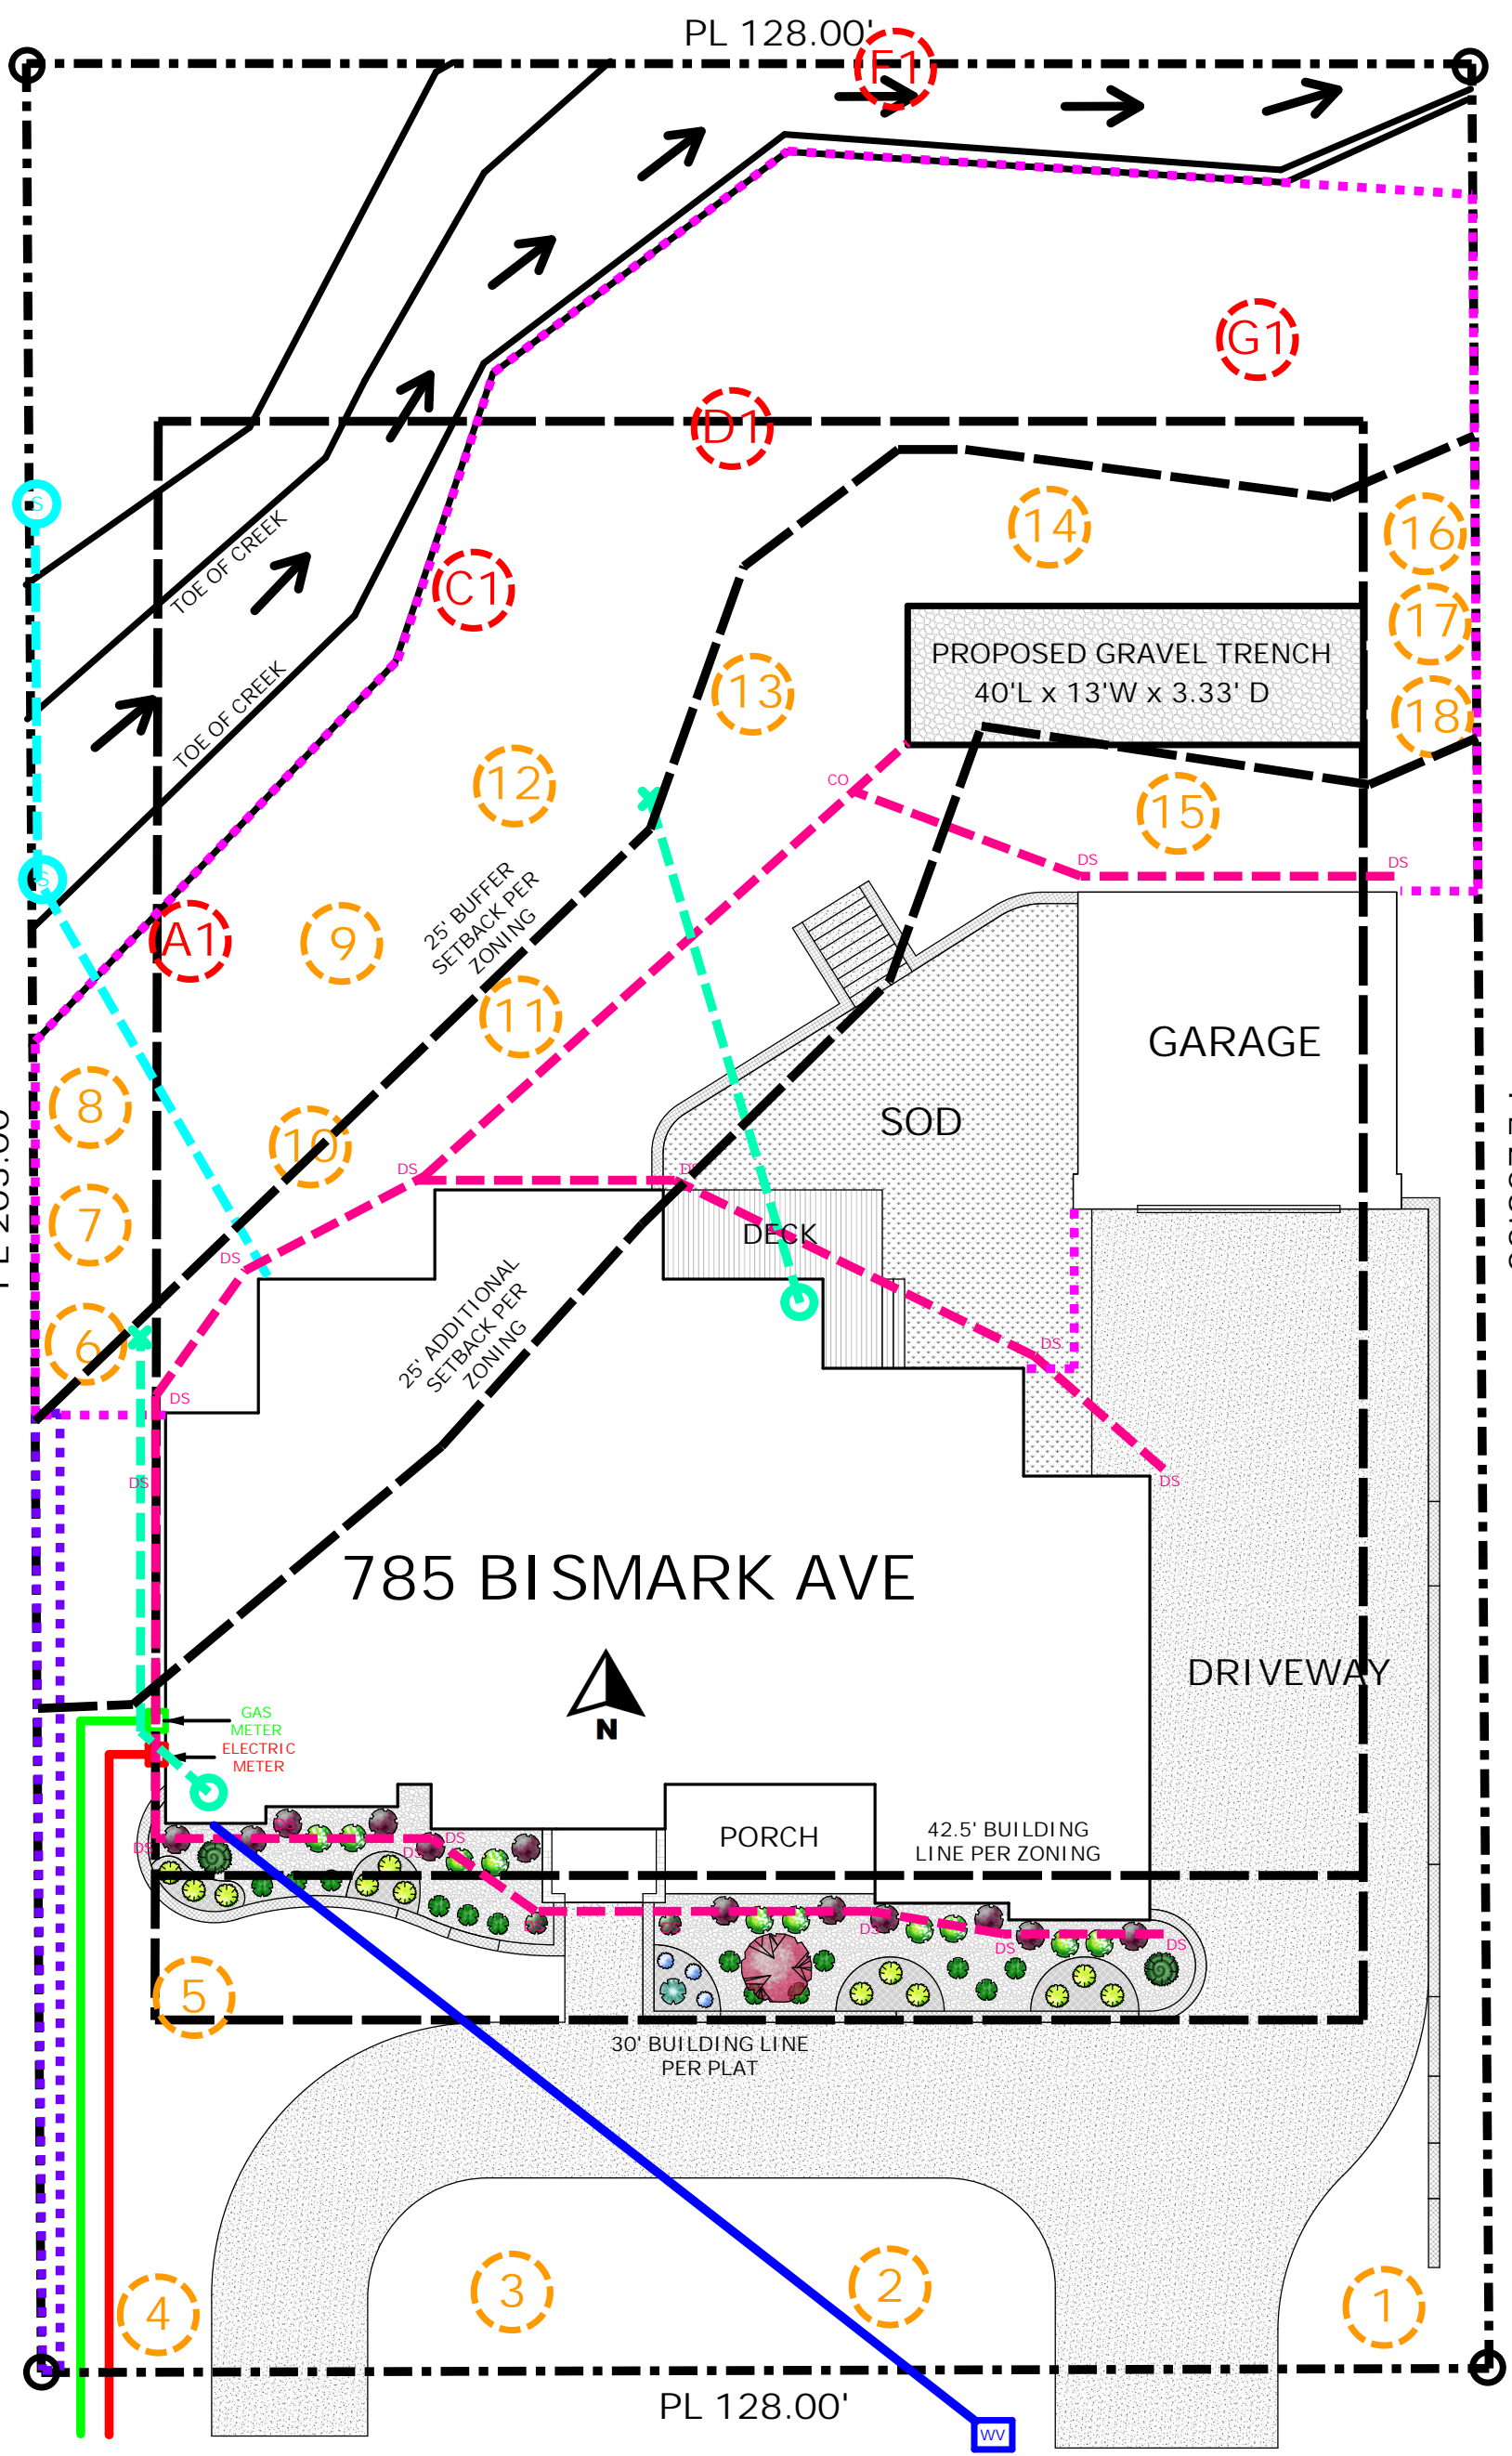

**PLOT LEGEND**

**PRESERVED TREES**

**PROPOSED REPLACEMENT TREES**

	GAS LINE		ELECTRICAL LINE
	WATER LINE		SUMP PUMP PIPE
	DOWNSPOUT LINE		SANITARY LINE
	PROPOSED FENCE LINE		PROPOSED BERM

	A1	Shagbark Hickory	17"		F1	Hackberry	20"
	C1	American Elm	32"		G1	Mockernut Hickory	8"
	D1	Hackberry	23"				

	1	Flowering Dogwood	2.5"		4	Sweetbay Magnolia	2.5"		7	Evergreen Tree	2.5"		10	Flowering Dogwood	2.5"		13	Bur Oak	2.5"		16	Evergreen Tree	2.5"
	2	Eastern Redbud	2.5"		5	Eastern Redbud	2.5"		8	Evergreen Tree	2.5"		11	Post Oak	2.5"		14	Mockernut Hickory	2.5"		17	Evergreen Tree	2.5"
	3	American Elm	2.5"		6	Evergreen Tree	2.5"		9	Swamp White Oak	2.5"		12	American Elm	2.5"		15	Shagbark Hickory	2.5"		18	Evergreen Tree	2.5"